


Layout drawing

Machine area make room for 1 m!

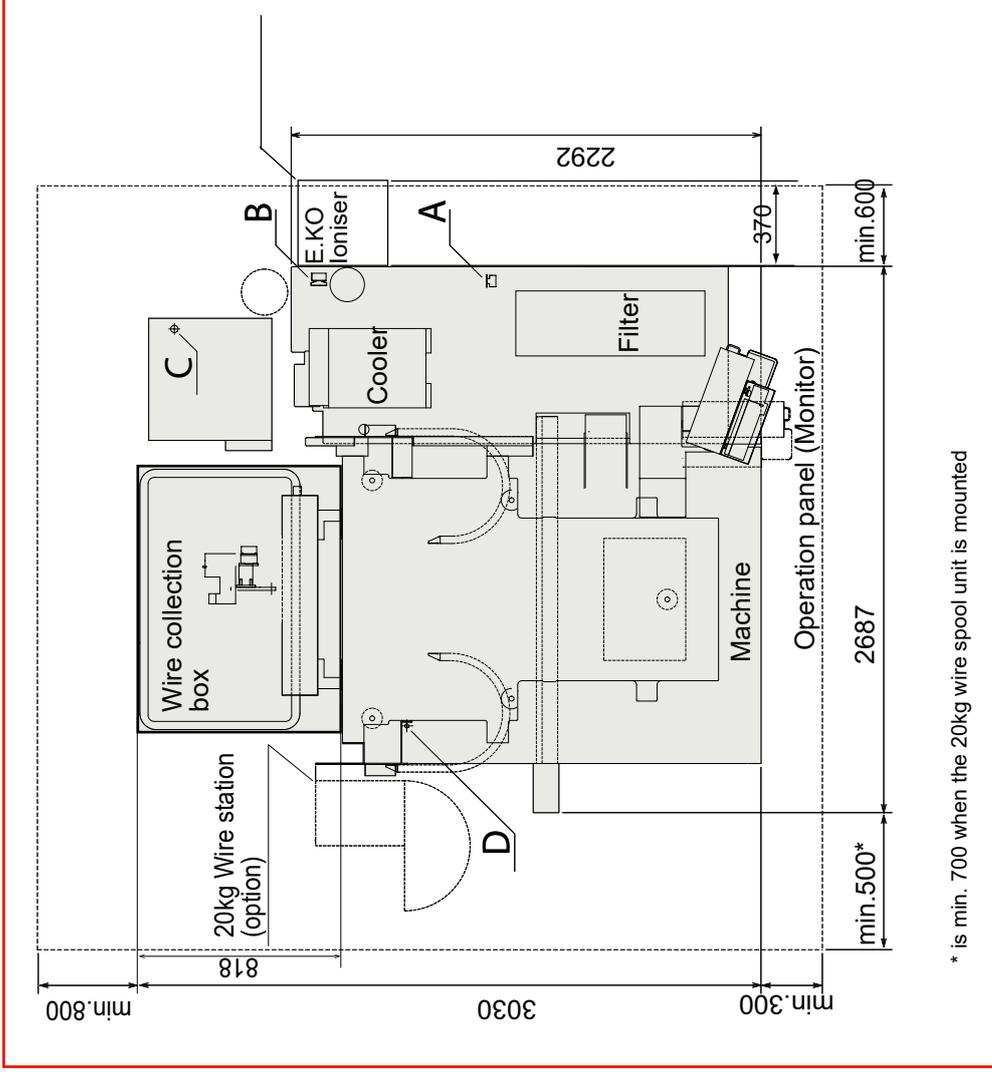

* is min. 700 when the 20kg wire spool unit is mounted

Additional information

Weight of machine body: 3500 kg
 Weight of tank without filling: 350 kg
 Weight of power supply unit: 240 kg
 Height of machine: 2150 mm

Requested minimum measurement for entrance door/gate (WxH): 2022 x 2150 mm

- 1: Power supply
 3 phases 400 V / AC, PE
 ± 10%, 50/60 Hz, 20 kVA
 Primary fuse min. 35 A slow

If necessary dependent on generator a transformer is necessary
 A transformer with the following measures belongs to the machine:
 WxDxH (0,8 m x 0,35 m x 0,9 m)
 Weight: 199 kg

The transformer is to be placed in a distance from max. 5 m to the machine. Here the max. cable length is to be considered to the cross section. The data are to be inferred from the documents of the transformer. (Cable not included in delivery volume)
 The transformer has to be connected to the electricity supply through a customer-sided provided electrician due to the different regulations for each region/country.

- 2: Water supply: Single filling of the system with water, no regular water connection is necessary.

- 3: Pneumatic connection: 5-7 kgf/cm³ » 500-700 kpa
 Air volume minimum: 42 l /min (more than 75 l/min when AT system with wire diameter 0,1 mm is used)
 3/8" hose connection

- 4: Network connection

- 5: E.KO-Ioniser dimension: WxDxH (370 x 660 x 1150 mm)

- 6: The erosion system should be set up to preferably consolidated concrete floors on a suitable hard industrial ground. To the capacity of MITSUBISHI, possibly necessarily becoming shielding measures do not belong in accordance with EMV guideline.



gezeichnet/drawn: Y. Ucar	Datum/Date: 25.02.19	Name/Name: Y. Ucar	Technische Änderungen vorbehalten Specifications subject to change without notice
geprüft/checked: 11.03.19		Y. Ucar	
überarbeitet/revised: 10.11.20		Y. Ucar	